
# **ECOLIFTING RETROFITS**


Busbar

A conductor rail is installed to the steel structure along a container stacking area, providing consistent electric power that is cleaner and cheaper than diesel.



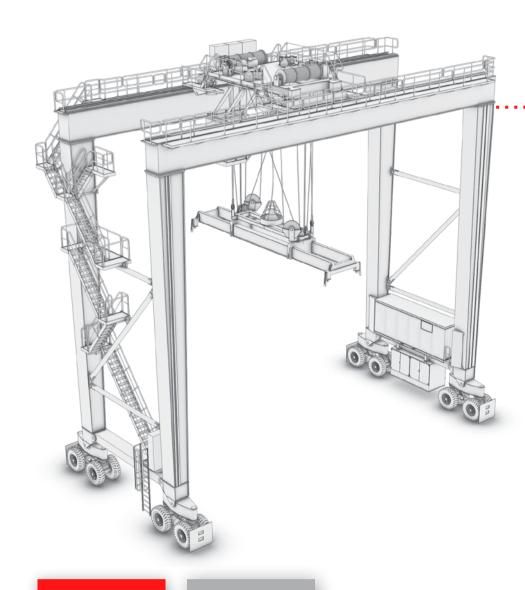

AB **Any Brand** 



**EQUIPMENT** 

applied to all Konecranes RTGs as well as any other crane brand.

controlled with PROFINET bus link.

RTGs should be PLC



**Busbar Power** 

59.0 kWh

**BENEFITS** 

consumption completely • Eliminates time spent refuelling

downtime is related to

• Eliminates diesel fuel

- Typically 25-30% of total
- diesel engine maintenance, electrification saves those costs • Optional: Drive In/Drive Out procedure can be automated with Konecranes proprietary
- Full diesel-genset remains available as back-up and auxiliary.

**Busbar Power** 

incl. Network

**Braking** 

27.5 kWh

"one button" feature

## **ASSUMED PARAMETERS** average load: 30t cycle: 12 boxes/h operational hours: 3600/year

**FUEL SAVINGS** 

## fuel cost: 95ct/l electrical energy cost: 11ct/kWh

**Diesel Engine Power with fixed without Network** speed mode **Braking** 

needed energy /h

| fuel cost /h                    | 13.50 €/h   | 6,50 €/h     | 3,00 €/h     |  |  |
|---------------------------------|-------------|--------------|--------------|--|--|
| running cost /year              | 47.790,-EUR | 23.376,-EUR  | 10.749,-EUR  |  |  |
| cost difference to diesel /year |             | -24.415,-EUR | -37.042,-EUR |  |  |
| up to% saving /year             |             | 50%          | 75%          |  |  |
|                                 |             |              |              |  |  |
|                                 |             |              |              |  |  |
| HOW IT WORKS                    |             |              |              |  |  |

14,8 l/h

### • The existing diesel genset remains on the RTG for container stack changes

• A special telescopic arm connects the RTG with the conductor rail and mains power • Coupling and uncoupling sequences are activated by

conductor rail system, consistently in-touch with the RTG

PLC control.

• The new electrical power supply source is fed by

• Auto-Steering smart feature is mandatory to operate RTG on virtual track alongside busbar rail • Customer is required to provide supplying conductor rail

voltage in same level as RTG's nominal board voltage

• Standard values are 400V up to max 690V. If there a

need to run different types of RTGs on one common

conductor rail, the RTGs need to match frequency and


- Customer is responsible for: • all site related civil works, infrastructure works and site related equipment, such as yard busbar system, pillar boxes, transformers, breakers, etc.

voltage of grid power

WHAT YOU NEED TO KNOW

**SELECTED REFERENCES** 

**POE** | Frt. Lauderdale

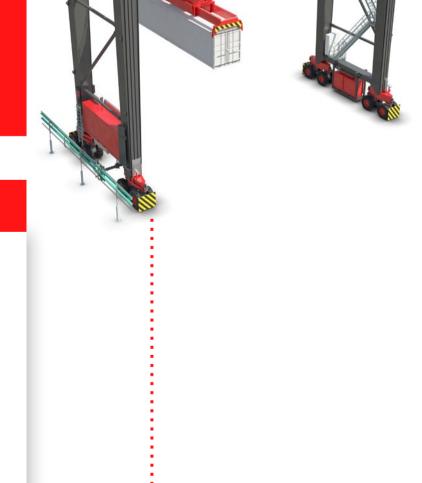

**Gulftainer** | Wilmington

LCT | Lomé

MSC | Valencia

| Year    | <b>Customer/Location</b> | Quantity |
|---------|--------------------------|----------|
| 2020/21 | Gulftainer / Wilmington  | 9        |
| 2019    | LCT / Lomé               | 11       |
| 2017/19 | MSC / Valencia           | 9        |
| 2015/16 | POE / Frt. Lauderdale    | 4        |
| 2013/10 | 1 oz / Tra zadacidale    | ·        |



process industries, shipyards, ports and terminals. Konecranes

for lifting equipment of all makes. The Group has more than 16,000 employees at 600 locations in 50 countries. Konecranes

shares are listed on the Nasdaq Helsinki (symbol: KCR).

provides productivity enhancing lifting solutions as well as services